

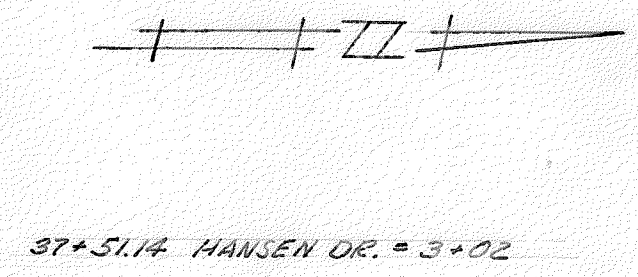


0.75 M.G. TANK SITE

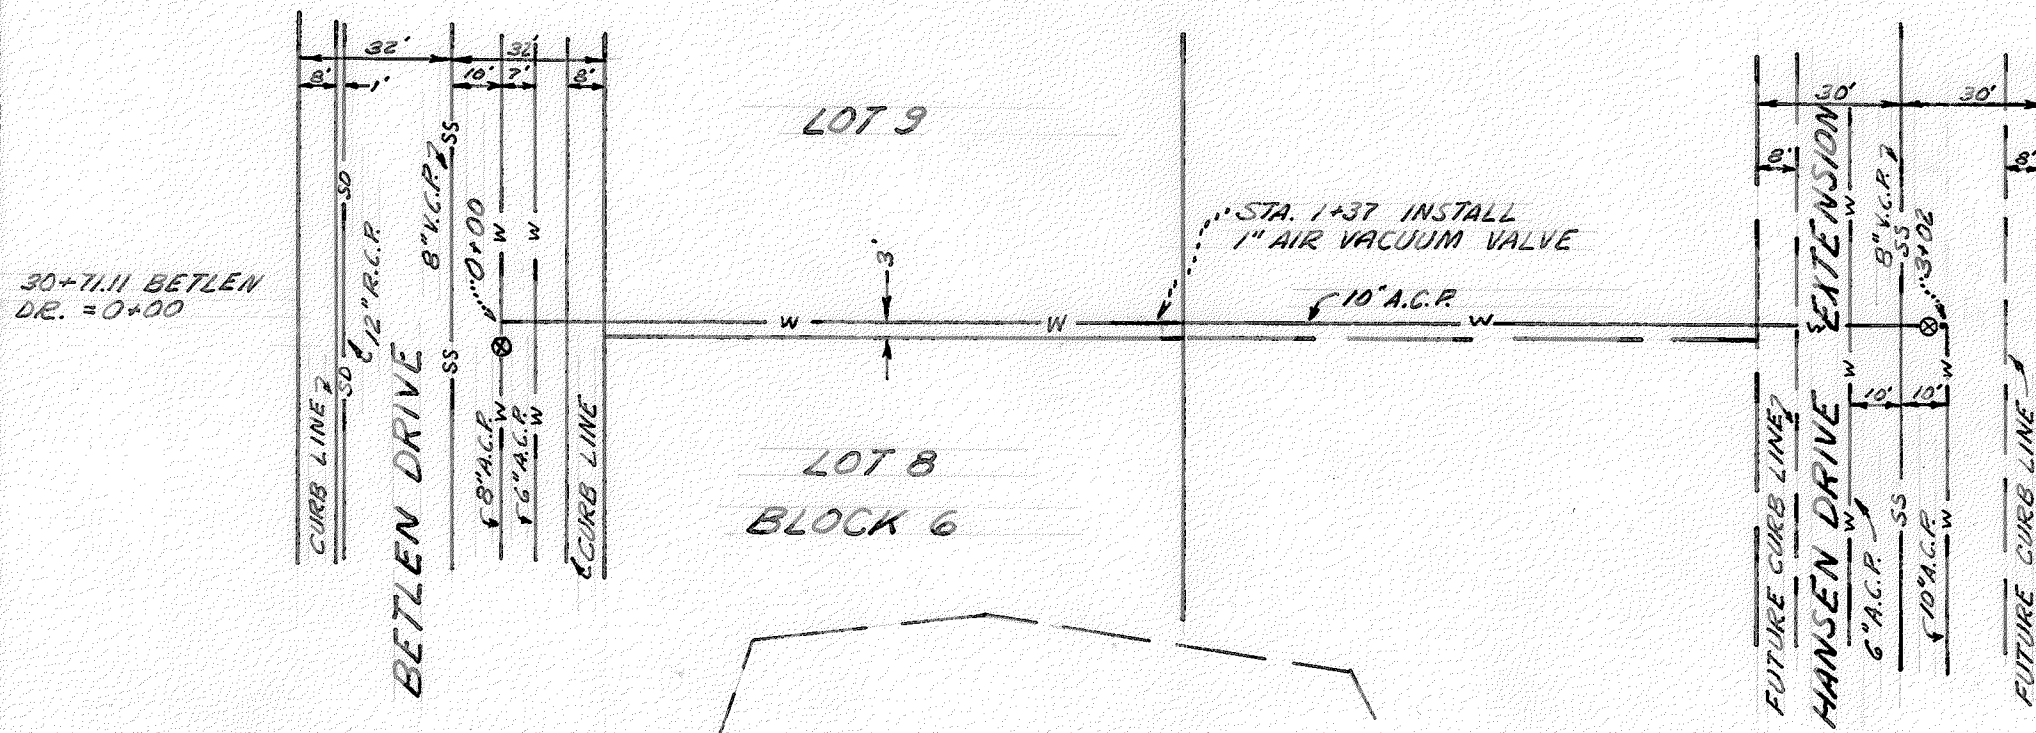

WATER SUPPLY SYSTEM APPROVED AS SHOWN HEREON.
 DATE: _____
 DISTRICT ENGINEER - VALLEY COMMUNITY SERVICES DISTRICT

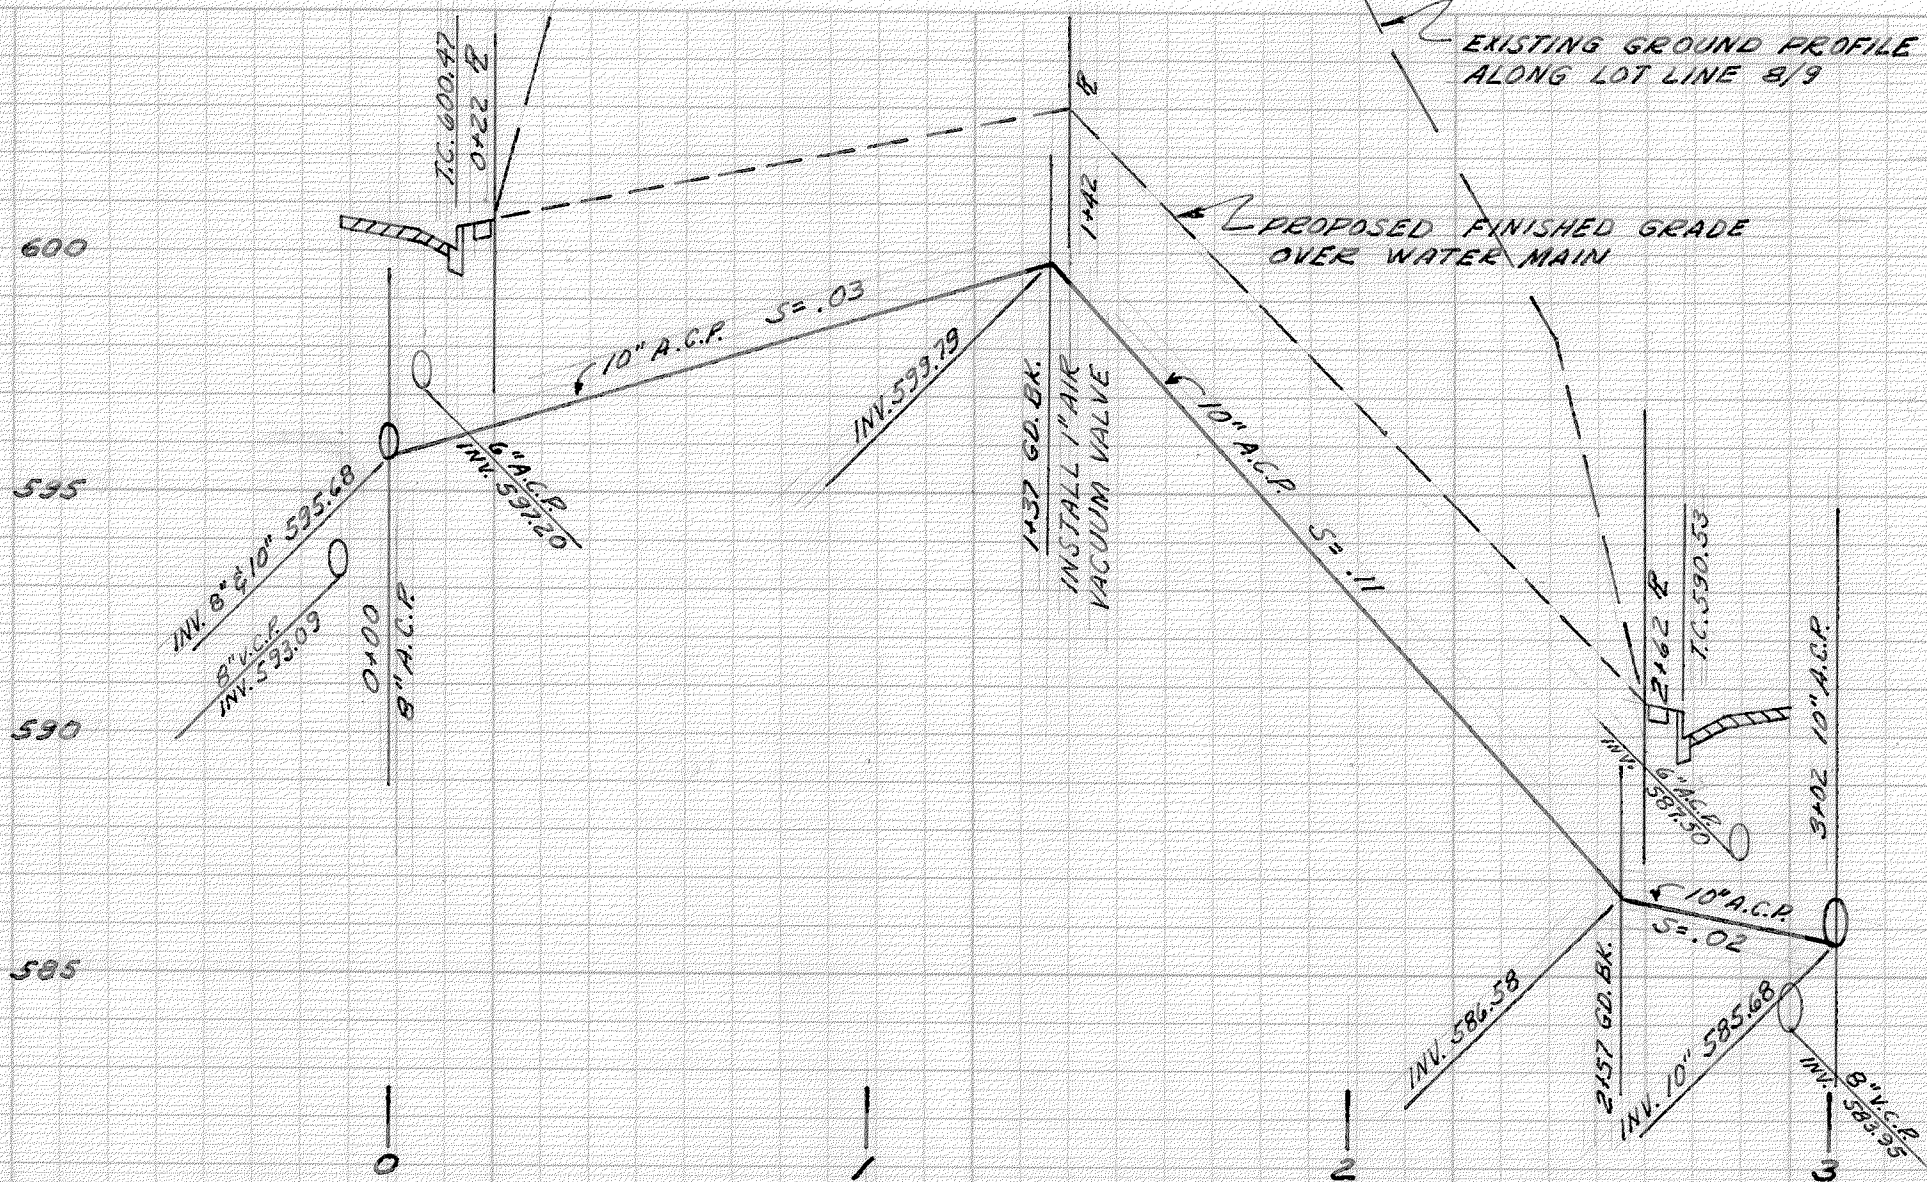

NOTE:
 ALL WORK SHALL BE IN ACCORDANCE WITH ALL RELATED GENERAL NOTES AS SHOWN WITHIN THE TRACT 2534 IMPROVEMENT PLANS AND WITH THE STANDARD SPECIFICATIONS OF THE V.C.S.D.

WATER MAIN REVISION
 TRACT 2534
 PLEASANTON TOWNSHIP, ALA. CO., CALIFORNIA

JOHN A. MANGINI, R.E. NO. 1532
 1279 "A" STREET, HAYWARD, CALIF.

HORIZ: 1"=40'
 VERT: 1"=4'

DEC, 1964
 William E. Bane
 R.C.E. #12386

SH. 1 OF 1 SH.

SURVEY NO. 6720